

RECENT LARGE-SCALE GROUND-SOURCE HEAT PUMP INSTALLATIONS IN IRELAND

Sarah O'Connell and Stephen F. Cassidy
Mechanical & Manufacturing Engineering Dept, CIT, Cork, Ireland

INTRODUCTION

Thermal energy consumption in Ireland is 1.032 Mtoe (155.67 TWh) for domestic heating. For the tertiary sector it is 0.421 Mtoe (63.50 TWh) (Dubuisson, 2002). Less than 1% of Irish households are heated using a heat pump. This contrasts sharply with Switzerland, one of the world leaders in heat pump technology, in which 67% of homes are equipped with a heat pump (Rybach and Sanner, 2000). The reasons for such a low number of installations in Ireland is due to a) low public awareness of heat pump technology and its advantages over conventional heating systems, b) air conditioning, which drove the heat pump market, especially in the US, is not required in Ireland, c) a lack of hot springs, a feature which usually promotes the use of ground source heat pumps (GSHP) and d) few installers to promote and install heat pump systems.

There are approx. 1000 domestic ground source heat pump installations in Ireland, typically in the range between 10 and 14 kW. Presently, there are approximately 18 large-scale commercial systems installed (Sikora, 2002). The installed thermal capacity in Ireland is 12 MWt. This paper deals with these large-scale commercial installations that have an output larger than 12kW. This figure was chosen so direct comparisons with other countries could be made using the data compiled by Lund and Freeston (2000) in their assessment of global geothermal energy.

While the number of GSHP systems currently installed in Ireland is low, there appears to be a large potential for growth in the area due to the prevailing climatic and soil conditions. Ireland has a mild climate due to the proximity of

Gulf Stream currents in the Atlantic Ocean. The average annual air temperature is 9°C. The lowest mean daily minimum temperature in winter is 25°C. The country has both a high rainfall rate, 800 to 2,800 mm per annum, and high relative humidity values are between 71% and 91% (Met Eireann, 2002). These factors combine to ensure a large moisture content in the soil thereby increasing its thermal conductivity. Saturated soil has a thermal conductivity value up to four times greater than dry soil. The overall geological composition in Ireland, 40% of parent soil composition at depths of 1m and greater consists of either Sandstone or Limestone (Gardiner and Radford 1980). Sandstone has a thermal conductivity of between 1.28 W/mK and 5.10 W/mK. Limestone has thermal conductivity between 1.96 W/mK and 3.93 W/mK. Average ground temperatures at depths of 1m and greater are between 9°C to 13°C (Connor 1998). Horizontal collector ground loops may thus be used in Ireland, as the collector will not encounter external frost since diurnal damping depths are 0.2m for sandstone, and 0.1m for damp soil consisting of organic matter. This, together with the easy availability of land and the cheaper installation cost over conventional vertical borehole collectors, means that horizontal collectors are the most common form of collector type used.

Installed ground-source heat pump capacity for Europe is shown in Figure 1. Total European installed capacity is 1,577 MWt of which the estimated installed capacity for Ireland is 12 MWt. The European annual growth rate is 15% (Rivoalen 2001). Geothermal heat pump installations in the U.S. have total capacity of 1,356 MWt,

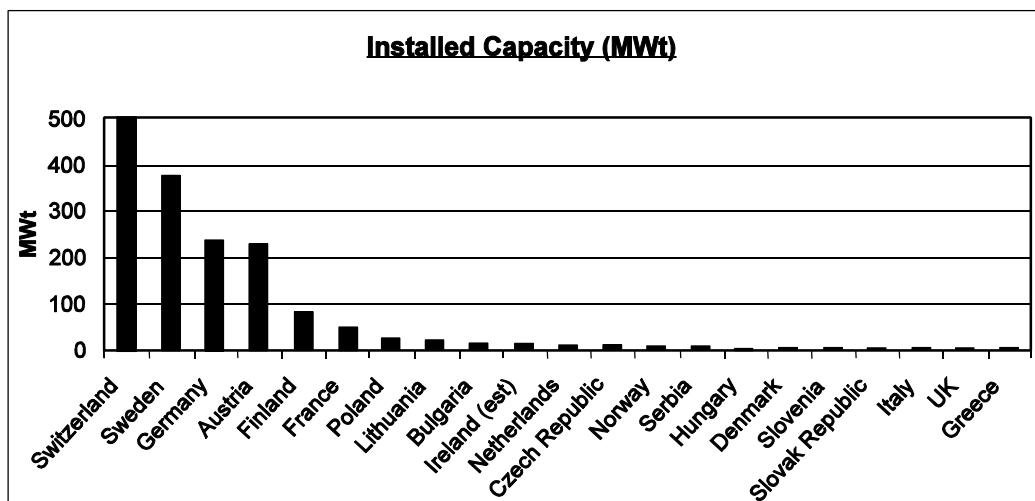


Figure 1. Installed ground-source heat pump capacity in Europe. (Lund and Freeston 2000).

comparable to the whole of Europe and are expected to increase at a rate of 10% annually (Lund and Freeston 2000). The estimated Irish annual growth rate is 44%. The high Irish growth rate is due to the lack of maturity in the heat pump market.

RECENT LARGE-SCALE GSHP INSTALLATIONS IN IRELAND

The following is an analysis of installations that have been recently installed in Ireland. Most have been extremely successful and indicate that ground-source heat pumps are

Table 1. Commercial GSHP Installations in Ireland

Building Location	Building Type	Installed	Collector Type	Collector Length (m)	Heat Pump (kW)	COP	Payback Period (years)	Estimated % CO ₂ Emissions Reduction
Trinity College, Dublin (out of commission)	4 University buildings		Aquifer Boreholes (solar add-on)	4 x 12	6 Heat Pumps 450 kW	~ 4	1.5 - 4	60
Motor Tax Office, Tralee, Co. Kerry	Office	1999	Horizontal Closed Loop	5100	130 kW	3.7	4	52 (B. & E. M. 2001)
Share Hostel, Cork.	Residential	2002	Shallow Aquifer Borehole	20	100 kW	3.5		30
Mallow Swimming Pool, Co. Cork	Swimming Pool	1987	Geothermal Aquifer Borehole	75	100 kW	4	11.5	
Carbery GAA, Co. Kildare	Sports Hall	2003	Direct Expansion Horizontal	440	46 kW	6 (max)		
Dolmen Centre, Co. Donegal	Sports Complex	2000	Horizontal Closed Loop	1800	45 kW (Dohan, 2002)	~ 3		45
Marlton House, Wicklow Town	Residential with Swimming Pool		Horizontal Closed Loop	2800	40 kW	3.5	6 - 8	45
Sports Centre Churchfield, Cork	Sports Complex	1997	Horizontal & Vertical	600 Horiz 120 Vert	34 kW (Cork Corp., 2002)	2.37		
Camp Hill Community, Callan, Co. Kilkenny	Residential Care Facility	1996	Artesian Well & Tubing on Roof		30 kW	3.5	6 - 8	45
Spiddal, Co. Galway	Private dwelling & swimming pool	2001	Horizontal Closed Loop	1500	30 kW	3.5	6 - 8	45
An Seanscoil, Co. Galway	Old School House		Horizontal Closed Loop	1500	30 kW	3.5	6 - 8	45
Caheroye House, Athenry, Co. Galway	Country Hotel	2002	Horizontal Closed Loop	1500	30 kW	3.5	6 - 8	45
Navan, Co. Meath	Private dwelling & Offices	2000	Pipe in stream Closed Loop	1500	30 kW	3.5	6 - 8	45
Briar Hill	Large Private Dwelling			1500	30kW	3.5	6 - 8	
Landfill Site Office, Kinsale Road, Cork.	Office	2000	Horizontal Closed Loop	2400	28 kW	3.5	4.5 - 6	30
Pairc Gno an Daingan, Co. Kerry.	Technology Park Offices	2002	Horizontal Closed Loop	960	26 kW			
Green Building, Temple Bar, Dublin	Apartments / Office / Retail	1994	Vertical Borehole	150	23 kW	4.87	2.5	86 (Cooper 1995)
Heritage House Ballyhooley, Co. Cork	Residential Listed building	1995	Air & Horizontal in compost	1050	19 kW	3.3 - 3.6	6	45

well suited to the Irish climate. The majority of these large scale installations have been in showcase buildings which feature a range of renewable energy technologies such as solar panels for hot water heating, sustainable building design and layout and natural ventilation. Table 1 gives a summary of these installations.

Horizontal collectors are the preferred option as vertical boreholes are 4 – 5 times more expensive to install in Ireland than horizontal systems (O'Brien 2002). The horizontal collectors have all been installed at a depth of 1m with the exception of the Churchfield installation, which was installed at 0.5m depth. Ireland is not a densely populated country with only 52 persons per square kilometre thus accounting for the availability of land to install horizontal collectors. Typically $\frac{3}{4}$ inch diameter pipe is laid in parallel and manifolded together.

The borehole collector at Mallow Swimming pool uses the Mallow geothermal aquifer as its source. The water from this aquifer has an average recorded temperature of 19°C. The borehole at Churchfield was installed to compare its performance with that of the horizontal collector. The horizontal loop proved to be more efficient (Collins, 1998). A vertical borehole was chosen for the Green Building in Temple Bar due to space restrictions. Some seepage from the bedrock also increases the heat pump COP. The decomposing waste at the Kinsale Road Landfill site is used as the heat source for the Administration building. The Share Hostel in Cork uses the Lee Valley aquifer, which, due to the heat island effect, has a water temperature of 12 – 13°C. The collector installed in Navan was placed on a stream bed and consists of stainless steel piping. Where possible, favorable geophysical features have been used for the collector, for example, the artesian well in Callan, Co. Kilkenny. In theory this should improve the system performance, however, the systems have not been monitored so the reduction in energy consumption has not been quantified.

The six heat pumps installed in Trinity College, Dublin range in size from 50 kW to 150 kW. The 30 kW systems in Galway and Mayo are a standard size and the associated horizontal collectors are 1500m in length. Tralee Motor Tax office is the largest installation serving a single building.

Mallow Swimming pool payback period is significantly higher because the project was the first of its kind in the country and encountered much higher exploration costs to determine the heating potential of the aquifer. For the Green Building in Temple Bar, the payback period for the entire building is estimated to be 18 years. As ground source heat pumps are a much more commercially attractive solution than other forms of renewable energy, they have a significantly shorter payback period than the building as a whole. For the Tralee Motor Tax office, the payback period was good due to its use for both heating and cooling. This can be accounted for by the very low running costs for the GSHP system. For example, in February 2001, heating costs amounted to approximately 15 euros per week.

For the Tralee Motor Tax office, CO₂ emissions were reduced by 52% as compared with a BRESCU type-3 office building. For the entire Green Building in Temple Bar, the reduction was 86%. This reduction was enhanced by the inclusion of foliant species as well as other renewable energies. The heat pumps in Trinity reduced CO₂ emissions by 920,000 kg CO₂/kWh annually. In Churchfield, a natural gas fired boiler is running continuously so there is a negligible reduction in emissions. CO₂ emissions for the other buildings have been estimated based on heat pump annual energy consumption and using BRECSU CO₂ emissions indicators (BRECSU, 2000). The 45% reduction is based on a comparison with an oil-fired boiler while the 30% reduction is based on comparison with Natural Gas where it is available.

Future projects include geothermal heating systems for Nursing home and health care projects with floor areas between 1200 – 1800m² in planning or progress. The Ballymun regeneration project in Dublin plans to install ground-source heat pumps in five houses to evaluate their practicality in high-density urban dwellings (Sikora 2002). Macroon Environmental Industrial Estate is a project initiated by Cork County Council. The pilot building will use an open loop water source heat pump to provide heating for the building. A 200kW system is under construction for University College Cork utilizing boreholes in a gravel aquifer. Inniscarra Environmental offices will have a buried horizontal loop installation with a proposed total heat output of 42kW, due to start on site in Sept 2003.

DISCUSSION

Running costs for GSHP systems in Ireland are significantly lower than other forms of heating. For example, a domestic oil boiler has running costs 66% greater than a ground-source heat pump. However, the high initial investment may be a deterrent to prospective users. Installation costs are 40% greater than oil or gas fired boilers, the most common forms of residential space heating, and 50% greater than electric storage heaters (O'Brien 2000). This is largely due to the lack of competition installing ground-source heat pump systems and the high cost of heat pump units. As the environmental and cost saving benefits of ground-source heat pumps becomes more widely known, this should encourage growth in the market and so reduce the initial installation costs. Organisations such as The Geothermal Association of Ireland, Sustainable Energy Ireland, and government funded Energy Offices at both national and local level are raising the profile of ground-source heat pumps in Ireland.

The increasing urbanization of Ireland will require GSHP installations to become more compact. An alternative to borehole heat exchangers is to install the collector under or in building foundations. This technology has never been applied in Ireland although it has been developed extensively in Austria mainly using foundation piles containing HDPE piping with brine as the heat transfer fluid. Collector piping has also been installed in raft foundations and diaphragm

walls (Brandl, 1998). This technology has also been implemented in Canada for a 211 kW heat pump capacity system under an office building (Caneta, 1999) and in the US for a 6-ton (21kW) sub-slab heat pump installation (Drown et al., 1992). A project is currently underway at Cork Institute of Technology to install a collector under the footprint of a building (O'Connell in prep.). The aim of this project is to demonstrate the technical and economic feasibility of locating collectors in the foundations of buildings in Ireland. This, it is hoped, will make the use of GSHP in the urban environment more widespread in Ireland.

Ireland exceeded the maximum permissible greenhouse gas emission target set by the Kyoto protocol at 13% over 1990 levels in 1999. To limit energy related CO₂ gas emissions, renewable energy may be used to reduce emissions of CO₂ by over 4.25 million tonnes which is over 35% of Ireland's target (Kellett, 2002). Ground-source heat pumps may contribute greatly to this reduction as they reduce CO₂ emissions by between 30% and 100% as compared with conventional heating systems (Dubuisson, 2002).

CONCLUSIONS AND RECOMMENDATIONS

The majority of the projects detailed in this paper have received funding incentives from local, national or EU level. It is hoped that these buildings will demonstrate the commercial viability of ground source heat pumps to the wider public and so increase the take up of this technology. The potential for ground source heat pumps in Ireland is extensive. At present the percentage of heating requirements met by heat pumps is insignificant. The potential primary energy savings for residential and tertiary sectors is 2.426 TWh/year equivalent to 80,000 units as estimated by Sustainable Energy Ireland. These would reduce CO₂ emissions by 617,000 tonnes CO₂/year and the primary energy requirement for heating would be cut by 5%. The extra investment required would be 602.6 million euros (Dubuisson, 2002).

The barriers preventing this potential from being realized include: higher capital cost of GSHP systems; higher perceived risk; price distortions (external cost of fossil fuels, subsidies for infrastructures); unfavorable market characteristics; lack of installation experience; absence of quality standards and, finally, low level of awareness among the general public and decision makers in government and county councils.

To encourage greater use of GSHP systems, the following measures should be undertaken:

- Subsidies for installation of domestic heat pumps as well as the existing subsidies for developers.
- Certified installers.
- Standards for new building codes with regard to technical/economic considerations for heat-pump installation.
- Standards for use of heating and cooling systems in buildings with air conditioning.
- Restrictions on use of fossil fuel and direct electricity heating.

- Carbon fuel tax.
- Continual research and development of heat-pump systems specially designed for conditions in Ireland.

ACKNOWLEDGMENTS

Funding received from the HEA under PRTL Cycle II Environmental Research Institute – New Energy Systems in Buildings. The author would also like to thank Dunstar Ltd (Clonakilty, Co. Cork) for technical expertise and information shared.

REFERENCES

- Brandl, H., 1998. "Energy Piles for Heating and Cooling of Buildings." *Seventh International Conference & Exhibition on Piling and Deep Foundations*, Vienna, Austria.
- BRESCU, 2000. *Energy Consumption Guide 19 – Energy Use in Offices*. UK Government Energy Efficiency Best Practice programme BRESCU.
- Building and Energy Management, 2001. *Energy Survey Report of Motor Tax Office, Tralee, Co. Kerry*. Report for Malachy Walsh & Partners, Cork, Ireland.
- Caneta, 1999. *A Ground Source System at the Trustcan Realty Office*. Report for Centre for the Analysis and Dissemination of Demonstrated Energy Technologies (CADDET), Canada.
- Connor, B. P., 1998. "National Survey on Low-Temperature Geothermal Energy." *Geothermal Association of Ireland Newsletter*. Issue no. 1 pp. 3.
- Collins, C., 1998. "Development of a Geothermal Heat Pump Test Facility." Masters Thesis, Department of Mechanical and Manufacturing Engineering, Cork Institute of Technology.
- Cooper, T., 1995. "Use of Energy Efficient Technologies to Minimize Fossil Fuel Derived Energy in a Landmark Building." Project report for Green Building Temple Bar. Trinity College, Dublin.
- Cork Corporation, 2002. "Knockfree Geothermal Project." Internal report, Cork City Energy Agency, Cork.
- Dohan, F., 2002. *The Dolmen Centre*. Personal correspondence, Portnoo, Co. Donegal.
- Drown, D.C.; Kast, T.P. and K. R. Den Braven, 1992. "A Ground-Coupled Storage Heat Pump System with Waste Heat Recovery." *ASHRAE Journal*, Vol.35, pp. 20-24.
- Dubuisson, X., 2002. "Sun in Action – The Sustainable Energy Revolution." Presentation to Irish Solar Energy Conference, June 2002, Tralee, Co. Kerry, Ireland.

- Dunstar Ltd., 2000. “ *System Description and Operation Manual for Solterra Geoenergy System using a York YCWM 120 Heat Pump.*” Operating Manual for Tralee Motor Tax Office, Co. Kerry, Ireland.
- Gardiner, M.J. and T. Radford, 1980. “*Soil Associations of Ireland and Their Land Use Potential – Explanatory Bulletin to Soil Map of Ireland 1980.*” Soil Survey Bulletin No. 36. National Soil survey of Ireland, An Foras Taluntais.
- Kellett, P., 2002. *Ireland's Natural Energy Opportunity: See the Light – No Bills from the Sun.* Presentation to Irish Solar Energy Conference, June 2002, Tralee, Co. Kerry, Ireland.
- Lund, J. W. and D.H. Freeston, 2001. “Worldwide Direct Uses of Geothermal Energy 2000”. *Geothermics*, Vol. 30 pp. 29-68.
- Met Eireann., 2002. www.meteireann.ie/climate/
- O'Brien, M., 2002. *Presentation to the Institute of Leisure Management March 21st 2002: Geothermal and Other Alternative Energy Uses in Cork Leisure Facilities.* Cork City Energy Agency, Cork, Ireland.
- O'Brien, M.; McGovern, C. and M. Walsh, 2000. “Geothermal Energy Utilization in Cork City.” *Geothermal Association of Ireland Newsletter. Issue no 3 pp. 4–6.*
- O'Connell, S. (in prep.). *Renewable Energy in Buildings – Ground-Source Heat Pumps.* Masters project in progress, Department of Mechanical and Manufacturing Engineering, Cork Institute of Technology, Ireland.
- Rivoalen, H., 2001. *Heat Pump Market Overview in Europe.* Report for EDF Research and Development group on Heat Pumps, Air Conditioning and Indoor air quality.
- Rybach, L. and B. Sanner, 2000. “Ground-Source Heat Pump Systems the European Experience.” *GHC Bulletin, March 2000. pp. 16–26.*
- Sikora, P., 2002. *Technology and Illustrative Large Scale Installations.* Personal correspondence, Dunstar Ltd, Clonakilty, Co. Cork.